


QTLP660CIR 1.8mm DOME LENS EMITTING DIODE

QTLP660CIR

PACKAGE DIMENSIONS

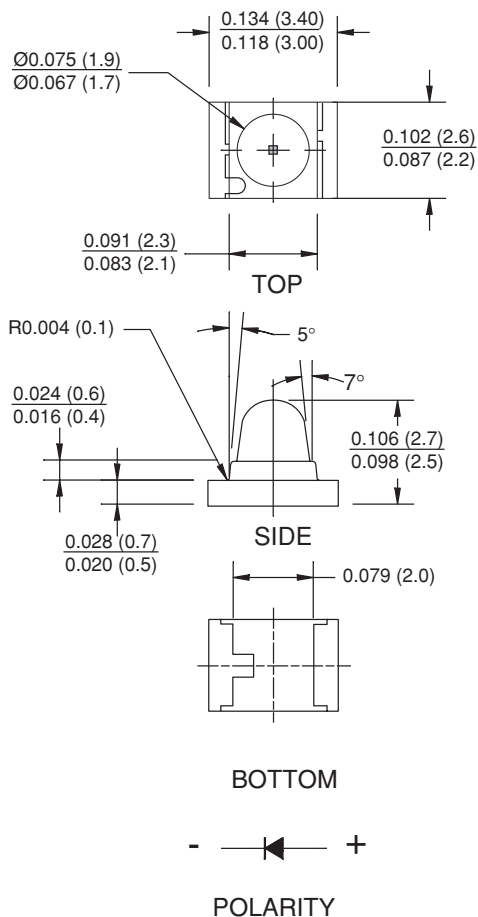

NOTE:
Dimensions for all drawings are in inches (mm).

FEATURES

- 1.8mm Dome Lens Package
- Available in 0.315" (8mm) width tape on 7" (178mm) diameter reel; 2,000 units per reel
- Narrow Emission Angle, 30°
- Wavelength = 940 nm, GaAs
- Water Clear Lens
- Matched Photosensor: QTLP660CPDF

QTL P660 CIR

1.8mm DOME LENS

EMITTING DIODE

QTL P660 CIR

ABSOLUTE MAXIMUM RATINGS ($T_A = 25^\circ\text{C}$ unless otherwise specified)

Parameter	Symbol	Rating	Unit
Operating Temperature	T_{OPR}	-40 to +85	$^\circ\text{C}$
Storage Temperature	T_{STG}	-40 to +90	$^\circ\text{C}$
Soldering Temperature (Iron) ^(1,2,3)	T_{SOL-I}	240 for 5 sec	$^\circ\text{C}$
Soldering Temperature (Flow) ^(1,2)	T_{SOL-F}	260 for 10 sec	$^\circ\text{C}$
Continuous Forward Current	I_F	65	mA
Reverse Voltage	V_R	5	V
Power Dissipation ⁽⁴⁾	P_D	130	mW
Peak Forward Current (Pulse width = 100 μs , Duty Cycle=1%)	I_{FD}	1.0	A

Notes:

1. RMA flux is recommended.
2. Methanol or isopropyl alcohols are recommended as cleaning agents.
3. Soldering iron tip at 1/16" (1.6mm) from housing
4. At 25°C or below

ELECTRICAL / OPTICAL CHARACTERISTICS ($T_A = 25^\circ\text{C}$)

PARAMETER	TEST CONDITIONS	SYMBOL	MIN.	TYP.	MAX.	UNITS
Peak Emission Wavelength	$I_F = 20\text{ mA}$	λ_P	—	940	—	nm
Emission Angle	$I_F = 20\text{ mA}$	Θ	—	± 15	—	Deg.
Forward Voltage	$I_F = 20\text{ mA}$	V_F	—	1.2	1.5	V
	$I_F = 100\text{ mA}$, $t_P = 100\text{ }\mu\text{s}$, Duty Cycle = 0.01		—	1.4	1.85	
	$I_F = 1\text{ A}$, $t_P = 100\text{ }\mu\text{s}$, Duty Cycle = 0.01		—	2.6	4.0	
Reverse Current	$V_R = 5\text{ V}$	I_R	—	—	100	μA
Radiant Intensity	$I_F = 20\text{ mA}$	E_e	1.0	3.0	—	mW/sr
	$I_F = 100\text{ mA}$, $t_P = 100\text{ }\mu\text{s}$, Duty Cycle = 0.01		—	14	—	
	$I_F = 1\text{ A}$, $t_P = 100\text{ }\mu\text{s}$, Duty Cycle = 0.01		—	140	—	
Rise Time	$I_F = 100\text{ mA}$,	t_r	—	1	—	μs
Fall Time	$t_P = 20\text{ ms}$	t_f	—	1	—	μs

QTLP660CIR 1.8mm DOME LENS EMITTING DIODE

QTLP660CIR

TYPICAL PERFORMANCE CURVES

Fig. 1 Forward Current vs. Ambient Temperature

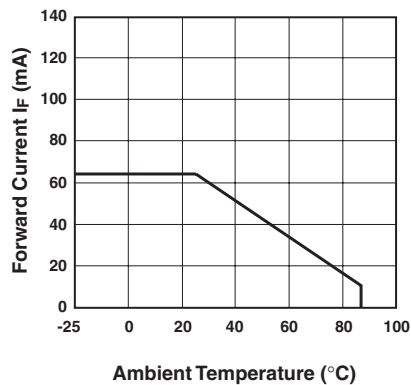


Fig. 2 Relative Radiant Intensity vs. Wavelength

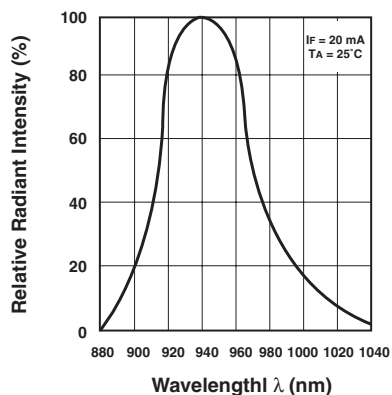


Fig. 3 Peak Emission Wavelength vs. Ambient Temperature

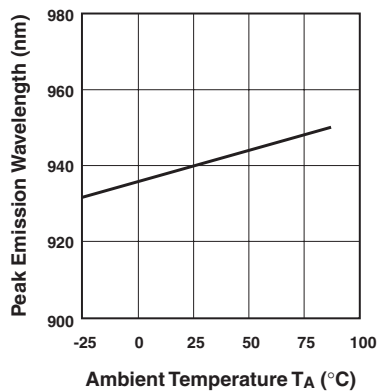


Fig. 4 Forward Current vs. Forward Voltage

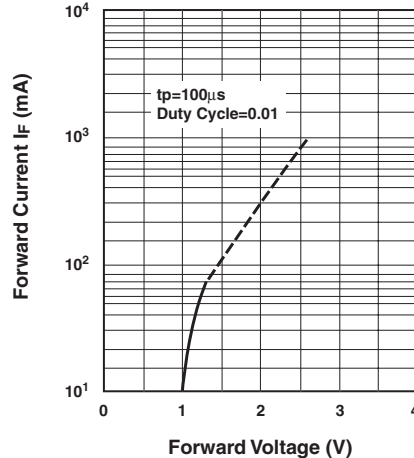


Fig. 5 Relative Intensity vs. Ambient Temperature (°C)


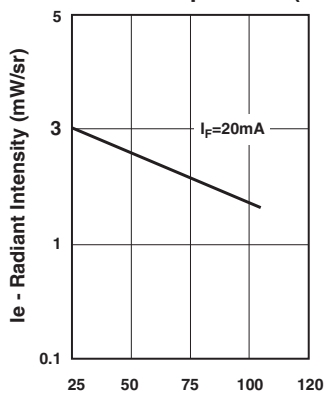


Fig. 6 Relative Radiant Intensity vs. Angular Displacement

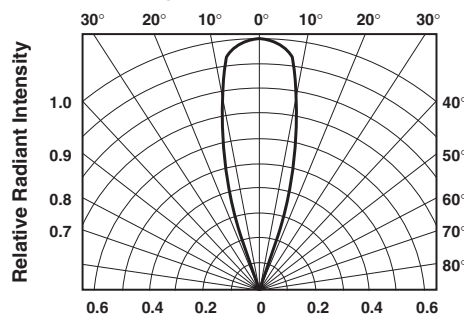

QTLP660CIR


1.8mm DOME LENS

EMITTING DIODE

QTLP660CIR

TYPICAL PERFORMANCE CURVES


Fig. 7 Relative Intensity vs.
Forward Current

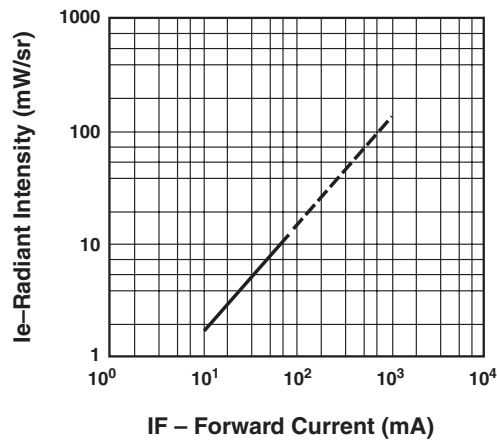


QTLP660CIR 1.8mm DOME LENS EMITTING DIODE

QTLP660CIR

RECOMMENDED PRINTED CIRCUIT BOARD PATTERN

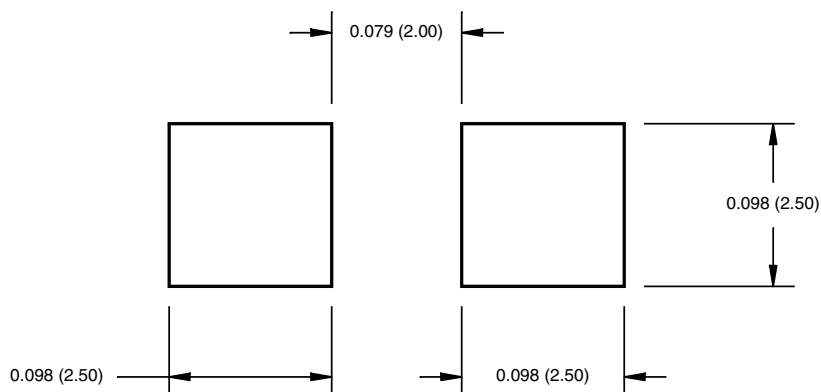


RECOMMENDED IR REFLOW SOLDERING PROFILE

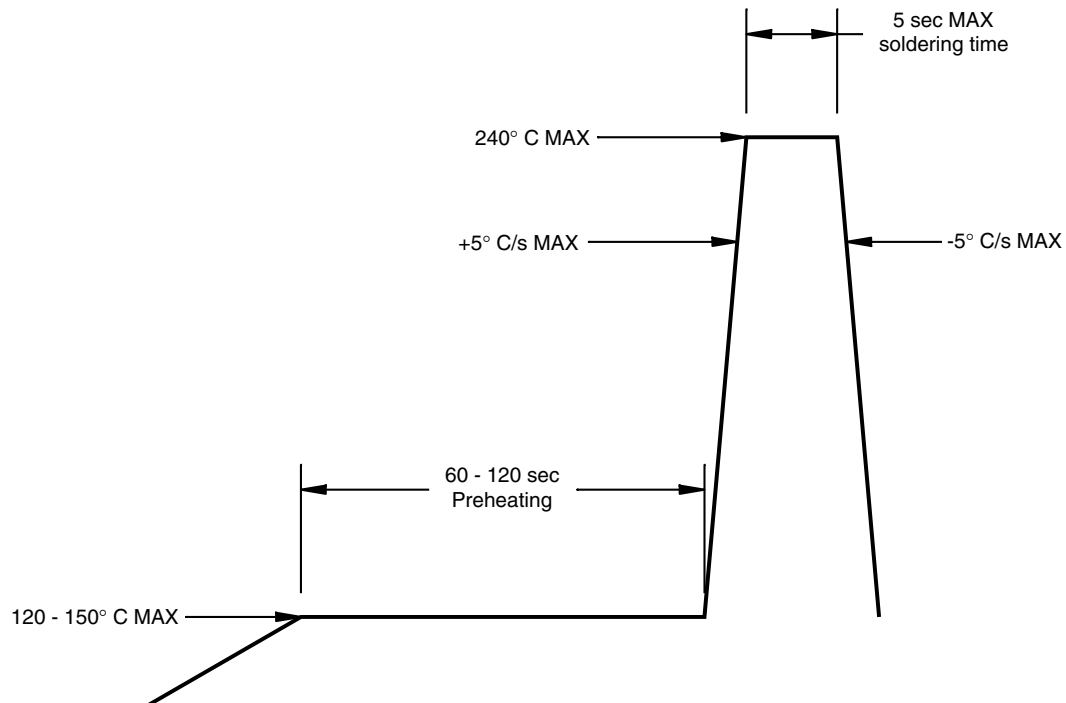

QTLP660CIR 1.8mm DOME LENS EMITTING DIODE

QTLP660CIR

TAPE AND REEL DIMENSIONS

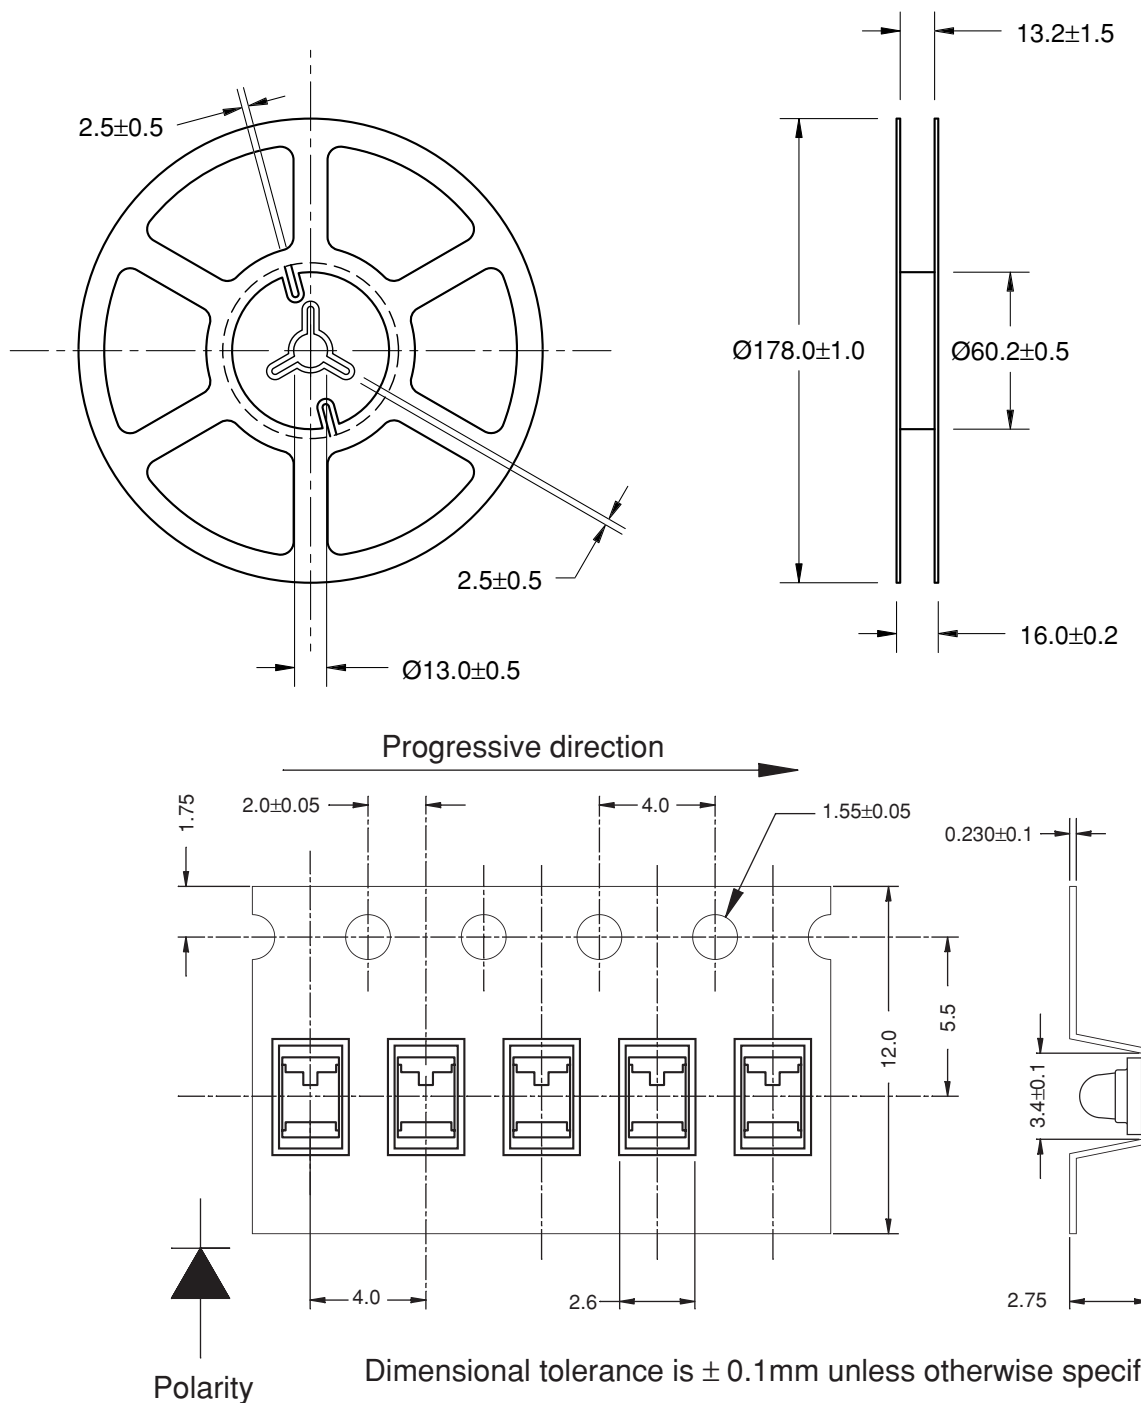

QTLP660CIR 1.8mm DOME LENS EMITTING DIODE

QTLP660CIR

DISCLAIMER

FAIRCHILD SEMICONDUCTOR RESERVES THE RIGHT TO MAKE CHANGES WITHOUT FURTHER NOTICE TO ANY PRODUCTS HEREIN TO IMPROVE RELIABILITY, FUNCTION OR DESIGN. FAIRCHILD DOES NOT ASSUME ANY LIABILITY ARISING OUT OF THE APPLICATION OR USE OF ANY PRODUCT OR CIRCUIT DESCRIBED HEREIN; NEITHER DOES IT CONVEY ANY LICENSE UNDER ITS PATENT RIGHTS, NOR THE RIGHTS OF OTHERS.

LIFE SUPPORT POLICY

FAIRCHILD'S PRODUCTS ARE NOT AUTHORIZED FOR USE AS CRITICAL COMPONENTS IN LIFE SUPPORT DEVICES OR SYSTEMS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE PRESIDENT OF FAIRCHILD SEMICONDUCTOR CORPORATION. As used herein:

1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.