



ELC-10PR

High-density Signal Conditioners *10-RACK*

PULSE SCALER

MODEL 10PR

MODEL & SUFFIX CODE SELECTION

MODEL _____ 10PR-□□0-R

INPUT _____

1 : Dry contact (max. frequency 100 kHz)
2 : Voltage pulse (max. frequency 100 kHz)

OUTPUT _____

1 : Open collector (max. frequency 20 kHz)
2 : 5V pulse (max. frequency 20 kHz)
3 : Relay contact (max. frequency 2 Hz)
4 : 24V pulse (max. frequency 20 Hz)

POWER INPUT _____

R : 24V DC


ORDERING INFORMATION

Specify code number and variables.

- Code number (e.g. 10PR-110-R)
- Input frequency range (e.g. 0 – 356.7 Hz)
- Output frequency range (e.g. 0 – 1.00 Hz)

REMARKS

1. The 10PR's output waveform is not uniform due to its scaling method.
2. Use input relays which do not cause chattering (e.g. mercury relays). Other relays could be used only with a CR filter, for 10 Hz at maximum.



GENERAL SPECIFICATIONS

Construction: rack-mounted; terminal access via screw terminals at the front and via card-edge connector at the rear; terminal cover provided

Connection: M3.5 screw terminals (nickel-plated steel; torque ≤ 0.8 N·m) and card-edge connector

Housing material: flame-resistant resin (black)

Power input: supplied from card-edge connector


Power fuse: 0.5A

Isolation: input to output to power

Input pulse sensing: capacitor coupled; detecting pulse rise

Sensitivity adjustment: single-turn screwdriver adjustment (front); 25mV p-p – 5V p-p

Scaling factor: $0.9999 \times 10^0 - 0.0001 \times 10^{-6}$



Functions & Features

- Converting pulse rate into convenient engineering unit for display on a totalizing counter or meter
- Fuse

Typical Applications

- Positive displacement flowmeters and turbine flowmeters
- Magnetic tachometers

INPUT & OUTPUT

■ INPUT

Maximum frequency: 100 kHz

Pulse width time requirement: 5 μ sec. min. (20 msec. min. for frequencies ≤ 10 Hz)

- Dry Contact: mechanical contact or open collector
Sensing: approx. 7.5V DC @1mA
ON/OFF level: $\leq 20k\Omega$ for ON, $\geq 100k\Omega$ for OFF

- **Voltage Pulse:** square or sine waveforms**
Input amplitude: 25mV p-p – 50V p-p
Minimum amplitude requirement


FREQUENCY	AMPLITUDE
0 – 2 kHz	25mV p-p
0 – 20 kHz	50mV p-p
0 – 40 kHz	1V p-p
0 – 100 kHz	5V p-p

With duty ratio other than 50% $\pm$ 10%

PULSE WIDTH	AMPLITUDE
5 μ sec.	5V p-p
10 μ sec.	3.5V p-p
50 μ sec.	2V p-p
100 μ sec.	1V p-p
500 μ sec.	0.5V p-p

Specifications subject to change without notice

Input impedance: 100k Ω minimum

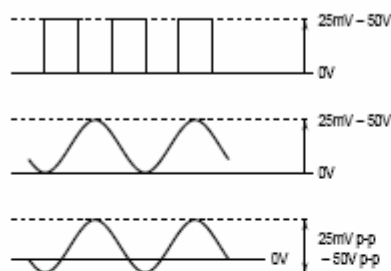

■ OUTPUT

•Open Collector: 50V DC @50mA (resistive load)
Frequency range: 0 – 20 kHz
ON pulse width: approx. 30 μ sec.
Saturation voltage: 0.6V DC

•5V Pulse

Frequency range: 0 – 20 kHz
Low pulse width: approx. 30 μ sec.
High level: 5V $\pm$ 10%
Low level: $\leq$ 0.5V
Load resistance: 600 Ω minimum

•Relay Contact: 120V AC @200mA ($\cos\phi=1$)
240V AC @100mA ($\cos\phi=1$)
24V DC @200mA (resistive load)

Frequency range: 0 – 2 Hz
ON pulse width: approx. 30 millisecc.
Relay life: $\geq 5 \times 10^7$ cycles (mechanical)
 $\geq 10^6$ cycles (electrical)

•24V Pulse

Frequency range: 0 – 20 Hz
Low pulse width: approx. 30 millisecc.
High level: 24V $\pm$ 10%
Low level: $\leq$ 0.5V
Load current: 30mA max.
Load resistance: 800 Ω minimum

INSTALLATION

Power input: 24V DC $\pm$ 10%, approx. 80mA
(ripple 10% p-p max.)

Operating temperature: -5 to +55°C (23 to 131°F)

Operating humidity: 30 to 90% RH (non-condensing)

Mounting: Standard Rack 10BX□

Dimensions: W25×H99×D180 mm (0.98"×3.90"×7.09")
See General Spec. Sheet Figure A-1.

Weight: 200 g (0.44 lbs)

Terminal assignment: See General Spec. Sheet Figure B-1.

PERFORMANCE

Insulation resistance: $\geq$ 100M Ω with 500V DC


Dielectric strength: 500V AC @1 minute

(input to output to power)


1500V AC @1 minute

(input or output or power to ground)

FRONT PANEL CONFIGURATION



SCHEMATIC CIRCUITRY & CONNECTION DIAGRAM

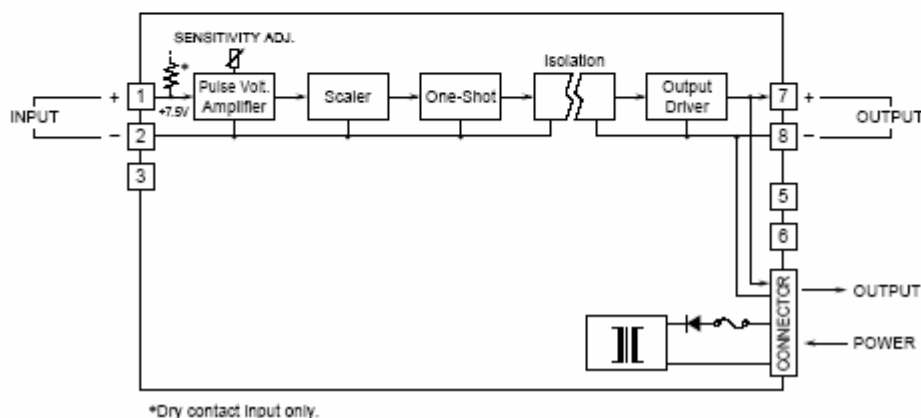

Enlaircon Pty Ltd

Website: www.enlaircon.com.au Email: sales@enlaircon.com.au

Phone: (612) 9909 0353 Facsimile: (612) 9909 0823

Postal Address: PO Box 697 Spit Junction NSW 2088 Australia